

FICHA TECNICA

CAPUCHA IGNIFUGA ABIERTA CON BROCHES

RIESGO: ELECTRICO

ATPV



CONFECCIONADO
EN PERU



RIESGO: FUEGO INDUSTRIAL



NORMA



TELA: Dril Ignifuga 300 TWILL (Carolina)
TIPO: Dril Anti flama
Composición: Algodón 100%
Peso: 305 gr/m2
ATPV: 13.2 cal/cm2
HAF: 78.1%
NFPA: 2112-2023
ASTM D5034
ASTM D1424



NABILA S.A.C.
JR. GIRIBALDI 704 - LA VICTORIA
Telf. 474-4444 / 711-2222
E-mail: ventas@nabila.pe

Nro. FT-

La Victoria, 2 de junio de 2026

ESPECIFICACIONES TÉCNICAS

81984571I00 - DRILL IGNIFUGA 300 TWILL

DESCRIPCIONES MÍNIMAS TELA	MODELO
	81984571I00
NOMBRE COMERCIAL	DRILL IGNIFUGA 300 TWILL
MARCA COMERCIAL	CAROLINA PROTECT
MATERIA TEXTIL	
TIPO DE TELA	DRILL ANTIFLAMA
COMPOSICION 1	ALGODÓN
%	100%
COMPOSICION 2	
%	
CONSTRUCCION	SARGA 3/1
GRADO DE ELABORACION	
ACABADO	ANTIFLAMA
GRAMAJE - GR/M2	305.00
UNIDAD COMERCIAL	METROS
ANCHO	1.70
DATOS ADICIONALES: ANCHO TOTAL: 170cm / 67" ANCHO CORTABLE: 165cm / 65" PESO: 305 g/m2 9 Oz/yd2 (+/- 5%) RESISTENCIA A LA TRACCION (ASTM D5034): Urdimbre: 641 N Promedio / 515 N Mín. Trama: 346 N Promedio / 275 N Mín. RESISTENCIA AL RASGADO (ASTM D1424): Urdimbre: 34.2 N Promedio / 26 N Mín. Trama: 29.2 N Promedio / 21 N Mín. ATPV: 13.2 cal/cm2 HAF: 78.1% NFPA 2112-2023 INSTRUCCIONES DE CUIDADO: Lavado en ciclo normal (máx. 50 °C), No utilizar blanqueadores (Cloro, lejía o peróxido de hidrógeno) ni suavizantes, Secado a máquina en temperatura baja (Máx. 65°C), Planchado a temperatura media y/o con vapor y No lavar en seco.	

DEPARTAMENTO COMERCIAL
NABILA S.A.C.

Este documento tiene una validez de 7 días,
desde su fecha de emisión.

Importante: Esta ficha técnica firmada tiene validez exclusivamente para clientes que puedan acreditar una compra efectiva del producto a través de nuestra empresa. Cualquier uso, reproducción o distribución sin respaldo comercial válido será considerado no autorizado.



Test Report for

Carolina Performance Fabrics S.A. de C.V.
Manuel Avila Camacho #570.
Naucalpan, Edo de Mexico, CP 53500
Mexico

Single Layer
Ignifuga® 300 Twill, 100% Cotton, 325 g/m²,
Olive

ARC RATING by ASTM F1959-05,
*Standard Test Method for Determining Arc Thermal Performance of Textile Materials
for Clothing by Electric Arc Exposure Method*

Kinectrics Inc. Report No.: K-422719-002-R01
December 3, 2007

PRIVATE INFORMATION

Kinectrics will not release details, or copies, of the report without the permission of the client.

Note about this report

- The test performed does not apply to electrical contact or electrical shock hazard
- The test result is applicable only to the Test Item, other material or color may have different protection level
- The findings of this report are based on the current test method as described in the Reference Standard
- It is assumed that the information supplied by the client was valid and complete

All tests were done under Kinectrics Quality Management System registered to ISO 9001 :2000 by QMI. Kinectrics Inc takes reasonable steps to ensure that all work performed shall meet the industry standards and that all reports shall be reasonably free of errors, inaccuracies or omissions. KINETRICS INC. DOES NOT MAKE ANY WARRANTY OR REPRESENTATION WHATSOEVER, EXPRESS OR IMPLIED, WITH RESPECT TO THE MERCHANTABILITY OR FITNESS FOR ANY PARTICULAR PURPOSE OF ANY INFORMATION CONTAINED IN THIS REPORT OR THE RESPECTIVE WORKS OR SERVICES SUPPLIED OR PERFORMED BY KINETRICS INC. Kinectrics Inc. does not accept any liability for any damages, either directly, consequentially or otherwise resulting from the use of this report.

© Kinectrics Inc., 2007. THIS REPORT IS PROTECTED BY COPYRIGHT. Any reproduction distribution or copying, either in whole or in part, without Client's permission is prohibited.

Kinectrics Inc., 800 Kipling Avenue, Toronto, Ontario M8Z 6C4
Tel: 416-207-6305, FAX: 416-207-5717,
www.kinectrics.com

TEST REPORT

Test item: 1 layer of Ignifuga® 300 Twill, 100% Cotton, 325 g/m², Olive
Measured weight before test = 322 g/m²

Laundering: Laundered by UL laboratories 3 times using AATCC Test Method 135,
Procedure 3, IV, A, iii

Test Performed: Determination of the arc thermal performance value of material for use as
flame resistant clothing for workers exposed to electric arcs.

Witnessed: UL Project Engineer, Amanda H. Newsom

Reference Standard: **ASTM F1959-05**, *Standard Test Method for Determining Arc Thermal
Performance of Textile Materials for Clothing by Electric Arc Exposure Method*

RESULTS

Flat Panel Samples:

- | | |
|-----------------------------------|------------------------------|
| • Arc Rating, ATPV: | 13.2 cal/cm ² |
| • Heat Attenuation Factor, HAF: | 78 % |
| • After flame (Avg of 5 highest): | 0 sec |
| • Break-open: | no samples having break-open |

Notes and Observations:

- Test Parameters: Arc Gap= 30 cm, distance to the arc = 30 cm
- Arc current = 8 kA rms, duration of the arc was varied as indicated in Table 1
- At ATPV level
 - Fabric is charred on the front
 - Fabric is weak
 - Back is not discoloured
 - No melting or dripping

Garment Samples: No garments evaluated.

Description of Test Method

The Arc Rating is determined by the arc test method defined in the Reference Standard using material in the form of flat specimens. This test method determines the heat transport response through a fabric or fabric system when exposed to the heat energy from an electric arc. The heat transport response is assessed versus the Stoll curve, an approximate human tissue tolerance predictive model that projects the onset of a second-degree burn injury.


Once the burns are recorded, the determination of the ATPV is done by logistic regression. The logistic regression is an S-shaped distribution function as shown in Figure 1. The Arc Rating ATPV determined by this test method is the amount of energy that predicts a 50% probability of a second degree burn. When break-open of the last FR layer is observed, the analysis of the break-open threshold is performed to determine if this may occur first. The Arc Rating of the fabric is which ever occurs first, this is the lower value of the two.

Because of the variability of the arc exposure, different heat transmission values may be observed at individual panel sensors or incident energy monitors. The evaluation of each sensor is done in accordance with the procedure specified in the Reference Standard.

To allow the fabric to normalize to the environment, the fabric is kept in air-conditioned laboratory conditions for a minimum of 24 hrs before the test. The weight (density) of the fabric is one of the major factors affecting its thermal performance. For this reason, the density of the fabric is measured before the testing. This is an accurate process using die cut samples and a precision scale. The design density of the fabric reported by the manufacturer may be different from the density indicated in the Kinectrics test report for various reasons. The reported value is the density of the material at the time of the test. Factors including but not limited to the manufacturing process and shrinkage during laundering will affect the density of the material.


Individual test sheets, graphs, photographs of the samples and video of every test are provided in digital format to the Client for review.

Reported by:

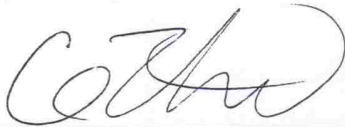

Colin Zhou, Technologist
High Current Laboratory

Reviewed by:



Claude Maurice, CET, BASc
Test manager
High Current Laboratory
claudemaurice@kinectrics.com



Terminology

Arc Rating, n —value attributed to materials that describes their performance to exposure to an electrical arc discharge. The arc rating is expressed in cal/cm^2 and is derived from the determined value of ATPV or E_{BT50} (should a material system exhibit a breakopen response below the ATPV value)

Arc Thermal Performance Value (ATPV), the incident energy on a fabric or material that results in a 50 % probability that sufficient heat transfer through the tested specimen is predicted to cause the onset of a second-degree skin burn injury based on the Stoll¹ curve.

Breakopen threshold energy (E_{BT50}), n —the incident energy on a fabric or material that results in a 50 % probability that sufficient heat transfer through the tested specimen is predicted to cause the tested specimen to break open. The specimen is considered to exhibit breakopen when any hole is at least 1.6 cm^2 [0.5 in.^2] in area or at least 2.5 cm [1.0 in.] in any dimension. In multiple layer specimens of flame resistant material, all the layers must breakopen to meet the definition. In multiple layer specimens, if some of the layers are ignitable, breakopen occurs when these layers are exposed.

Heat Attenuation Factor, HAF, n — in arc testing, the percent of the incident energy that is blocked by a material.


Stoll curve¹, n — an empirical predicted second-degree skin burn injury model, also commonly referred to as the *Stoll Response*.

SCD (Stoll Curve Difference)—The time dependent averaged heat energy response for each panel is compared to the Stoll Curve. A second-degree skin burn injury is predicted if the panel sensor heat energy response exceeds the Stoll Response value at any time (positive SCD). If the sensor response is below the Stoll Curve, no burn injury is predicted and a negative SCD is recorded.

¹Derived from: Stoll, A. M. and Chianta, M. A., "Method and Rating System for Evaluations of Thermal Protection," *Aerospace Medicine*, Vol 40, 1969, pp. 1232-1238 and Stoll, A. M. and Chianta, M. A., "Heat Transfer through Fabrics as Related to Thermal Injury," *Transactions—New York Academy of Sciences*, Vol 33 (7), Nov. 1971, pp. 649-670.


Figure 1: Determination of arc rating

Fabric Ignifuga® 300 Twill, 100% Cotton, 325 g/m², Olive
Description: measured weight before test = 322 g/m²

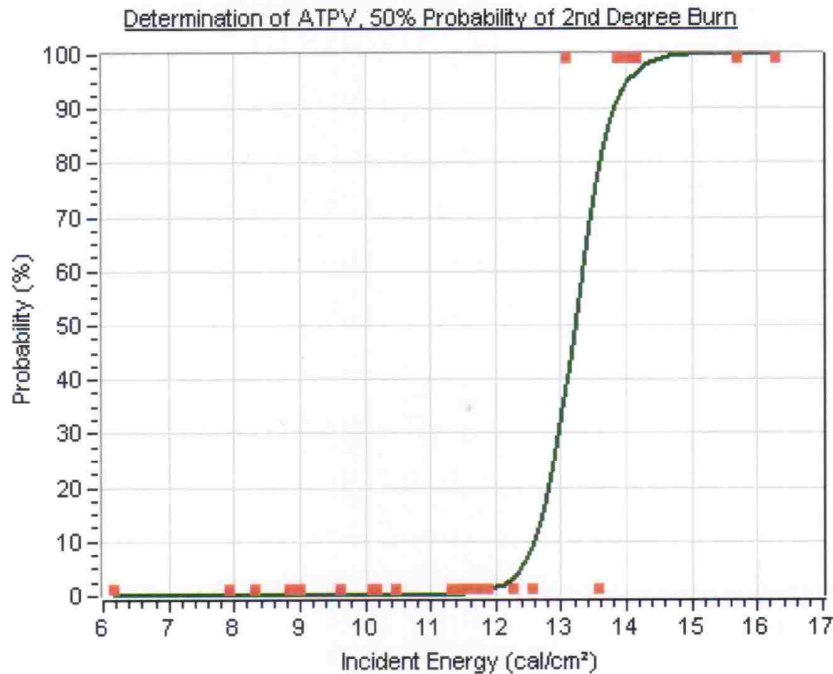**ATPV = 13.2 cal/cm²**

Probability of Burn	Ei
5%	12.4
10%	12.6
20%	12.8
30%	13.0
40%	13.1
50%	13.2
60%	13.3
70%	13.5
80%	13.6
90%	13.8

Pts = 27
 # Pts above Stoll = 8
 # Pts Break-Open = 0
 # Pts always >STOLL = 7
 # Pts always <STOLL = 18
 # Pts within 20% = 16
 # Pts in mix zone = 2

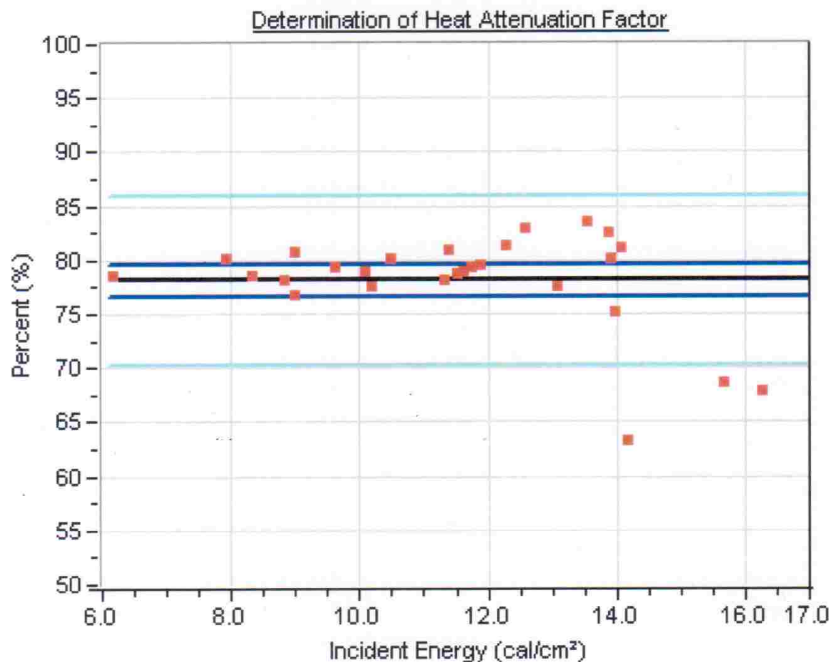**HAF = 78.1 %**

Confidence Intervals
 95% CI = 76.6 , 79.6

Data pts

Best Fit

95% CI

95% CI pts

Fabric Description: Ignifuga® 300 Twill, 100% Cotton, 325 g/m², Olive measured weight before test = 322 g/m²

[illegible]

Test 07-186: 11.5, 14.2, 14.0 cal/cm², near the ATPV level, front and back views
Front surface is charred, large area charred on the back, very weak

